
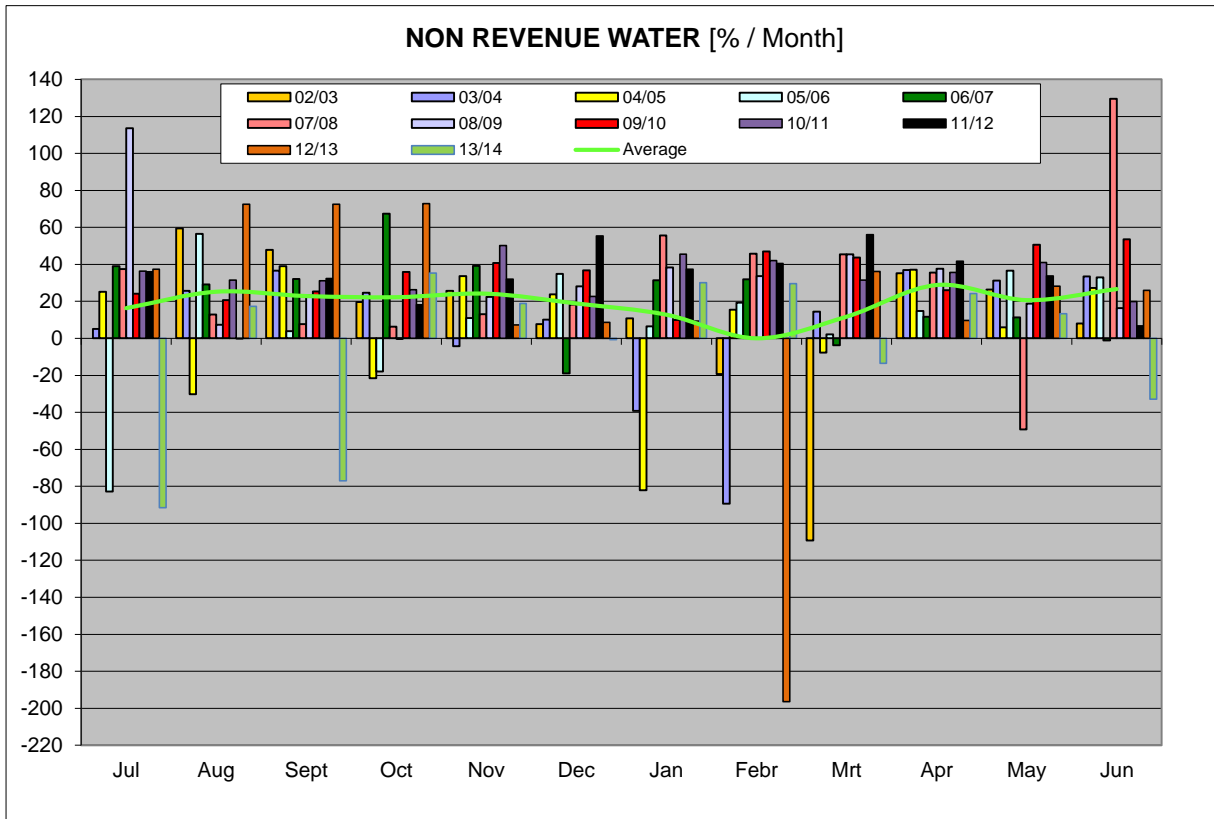


SWARTLAND MUNICIPALITY												
PPC												
Month	Year	BLK WATER SUPPLY				TREATED WATER SUPPLY				TOTALS (ONLY NETWORK LOSSES)		
		Raw Water Supply	Treated Water	Monthly Losses [m³]	Monthly Losses [%]	Consumption	Monthly Losses [m³]	Monthly Losses [%]	Monthly Losses [m³]	Monthly Losses [%]	Annual Losses [m³]	Annual Losses [%]
Jan01												
Feb01												
Mar01												
Apr01												
May01												
Jun01												
Jul01												
Aug01												
Sep01												
Oct01												
Nov01												
Dec01												
Jan02												
Feb02												
Mar02												
Apr02												
May02												
Jun02												
Jul02												
Aug02												
Sep02												
Oct02												
Nov02												
Dec02												
Jan03												
Feb03												
Mar03												
Apr03												
May03												
Jun03												
Jul03												
Aug03												
Sep03												
Oct03												
Nov03												
Dec03												
Jan04												
Feb04												
Mar04												
Apr04												
May04												
Jun04												
Jul04												
Aug04												
Sep04												
Oct04												
Nov04												
Dec04												
Jan05												
Feb05												
Mar05												
Apr05												
May05												
Jun05												
Jul05												
Aug05												
Sep05												
Oct05												
Nov05												
Dec05												
Jan06												
Feb06												
Mar06												
Apr06												
May06												
Jun06												
Jul06												
Aug06												
Sep06												
Oct06												
Nov06												
Dec06												
Jan07												
Feb07												
Mar07												
Apr07												
May07												
Jun07												
Jul07												
Aug07												
Sep07												
Oct07												
Nov07												
Dec07												
Jan08												
Feb08												
Mar08												
Apr08												
May08												
Jun08												
Jul08												
Aug08												
Sep08												
Oct08												
Nov08												
Dec08												
Jan09												
Feb09												
Mar09												
Apr09												
May09												
Jun09												
Jul09												
Aug09												
Sep09												
Oct09												
Nov09												
Dec09												
Jan10												
Feb10												
Mar10												
Apr10												
May10												
Jun10												
Jul10												
Aug10												
Sep10												
Oct10												
Nov10												
Dec10												
Jan11												
Feb11												
Mar11												
Apr11												
May11												
Jun11												
Jul11												
Aug11												
Sep11												
Oct11												
Nov11												
Dec11												
Jan12												
Feb12												
Mar12												
Apr12												
May12												
Jun12												
Jul12												
Aug12												
Sep12												
Oct12												
Nov12												
Dec12												
Jan13												
Feb13												
Mar13												
Apr13												
May13												
Jun13												
Jul13												
Aug13												
Sep13												
Oct13												
Nov13												
Dec13												
Jan14												
Feb14												
Mar14												
Apr14												
May14												
Jun14												

ANNUAL TOTALS			
Year	Supply	Consumption	Losses %
2002/2003	5376	4812	89.3%
2003/2004	5656	5324	94.1%
2004/2005	5110	4744	92.8%
2005/2006	4825	3879	79.9%
2006/2007	4955	3283	66.3%
2007/2008	5482	3476	63.4%
2008/2009	5738	3746	65.3%
2009/2010	6512	4194	64.4%
2010/2011	6449	3969	61.6%
2011/2012	6800	3861	56.6%
2012/2013	6887	4320	62.7%
2013/2014	6814	4446	65.1%

WATER BALANCE AND USAGE FOR THE PPC DISTRIBUTION SYSTEM

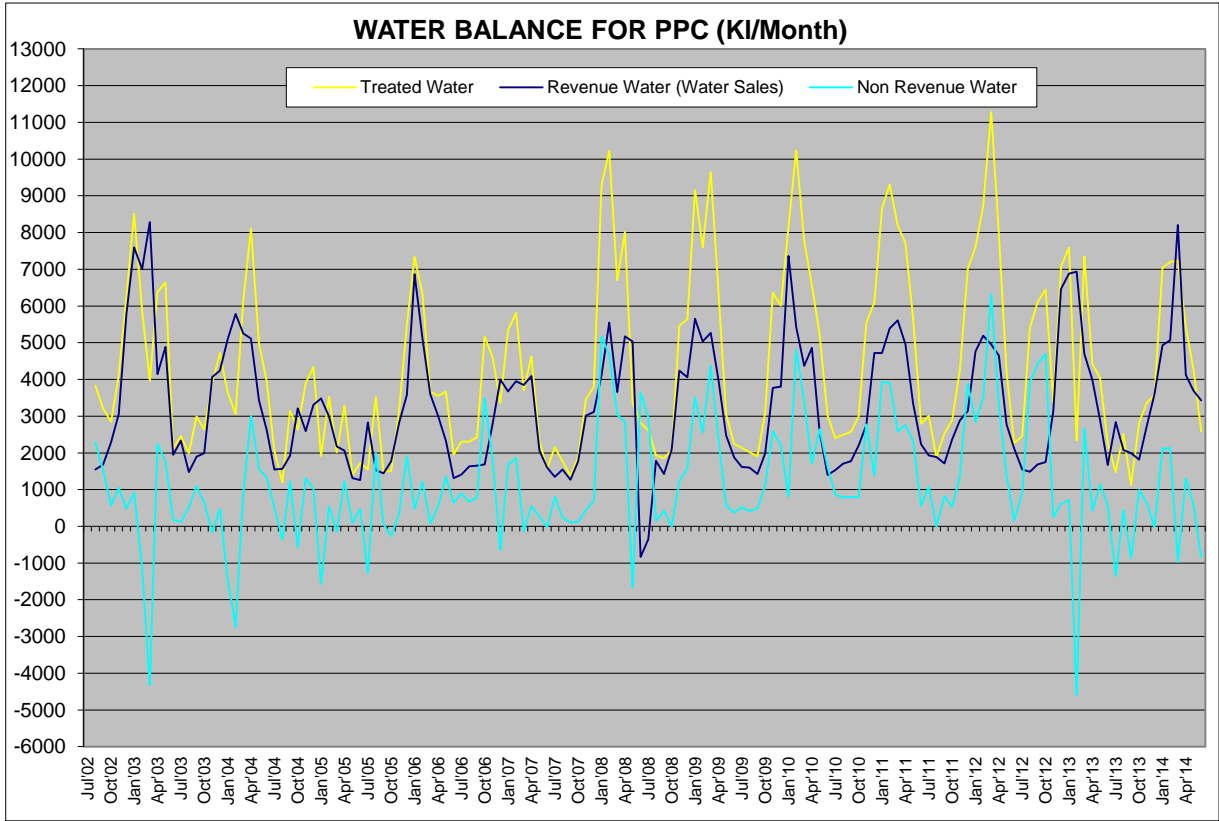

WATER BALANCE AND USAGE FOR THE PPC DISTRIBUTION SYSTEM

